
HAZARDOUS AREA WIRING

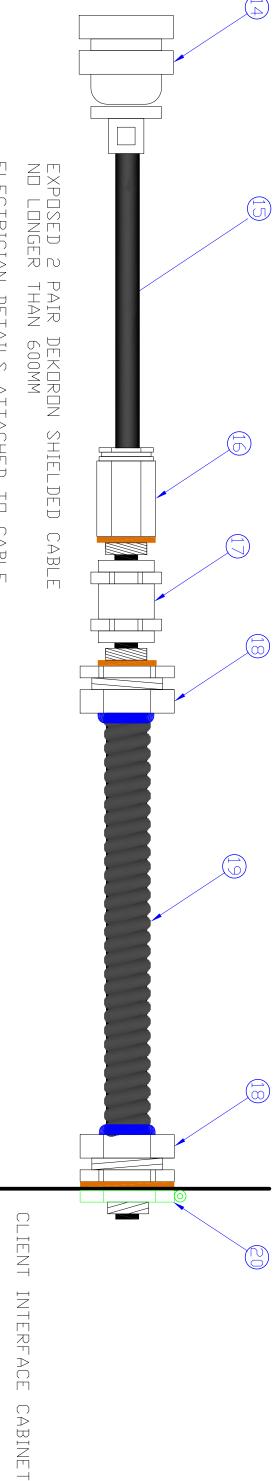

ELECTRICIAN DETAILS ATTACHED TO CABLE

NOTES: ITEM 14 FOR CONNECTION TO MEACHANICAL INDEX FOR CONNECTION TO CORRECTOR — CANNON PLUG NOT REQUIRED LEAVE 1M MINIMUM CABLE FROM ITEM 16 INSTALLATION OF CABLE NOT TO IMPEDE/ RESTRICT MAINTENANCE METER

20	19	18	17	16	15	14	ITEM	
EARTHING LOCKNUT 20MM	20MM ANACONDA CONDUIT	GLAND N/P BR IP68 M20 FOR LTP20	COUPLING 20MM STEEL FEMALE SOCKET	FLAME PROOF GLAND	2 PAIR DEKORON CABLE	CANNON 3 WAY PLUG	DESCRIPTION	HAZARDOUS AREA CABLE COMPONENTRY
536201	LTP20B	LTP20-M20-C	B-M20-C	ALCHUW20SB	EAS7302P		MODEL	INENTRY

This drawing is designed by Jemena Asset Management for the Client and is held by JAM on behalf of the Client. No part of this drawing may be reproduced, stored in a retrieval system in any form or transmitted be any means or used for any other purpose including manufacture without the prior written permission of the company

REV 0

PARTICULARS

CHKD/ENG DATE DRAWN APPR

CC

28/03/11 IA

50

PROJECT No.

APPROVED

ENGINEER

CHECKED

DRAWN

DATE 16/03/11

NTS

SCALE

 C_{C}

 $\mathbb{C}\mathbb{G}$

 C_{C}

 \exists

ISSUED FOR CONSTRUCTION

Jemena Asset Management Pty Ltd ABN 53 086 013 461

COMP REF:

CUSTOMER SINGLE CLI



11-JGN--MTR-DET-E-003